



CONCRETE SLAB 6" MIN. THICKNESS, REINFORCED WITH #4 EPOXY COATED REINFORCING RODS PLACED 10" ON CENTER IN BOTH DIRECTIONS THROUGH OUT THE SLAB. THEY SHALL BE PLACED TO BE 3" CLEAR OF SLAB EDGES. SLAB SHALL BE PLACED ON 6" OF COMPACTED CL 5 AGGREGATE BASE.

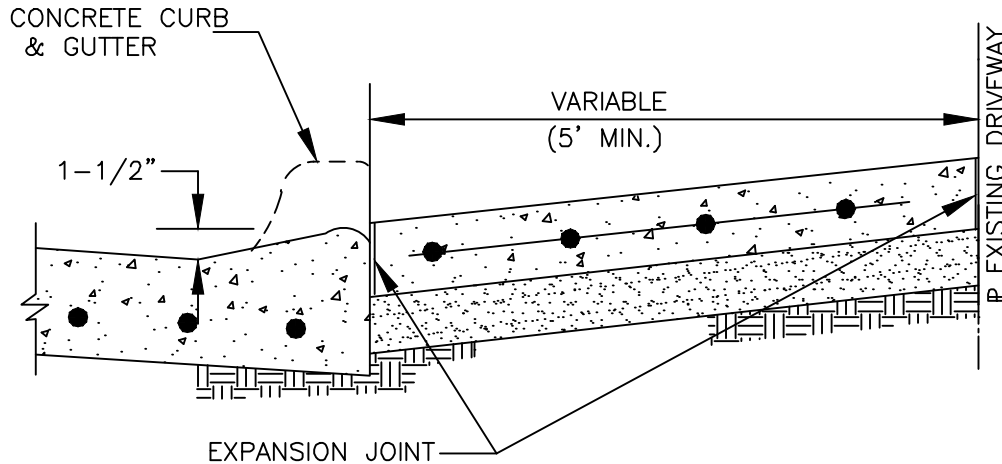


SECTION A-A

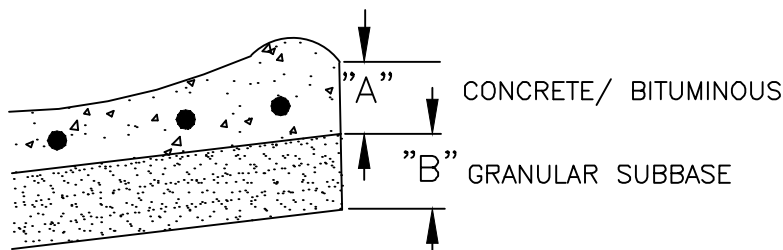

SECTION B-B

	CONCRETE	BITUMINOUS
"A"	6"	3"
"B"	6"	6"
"C"	3'	3'

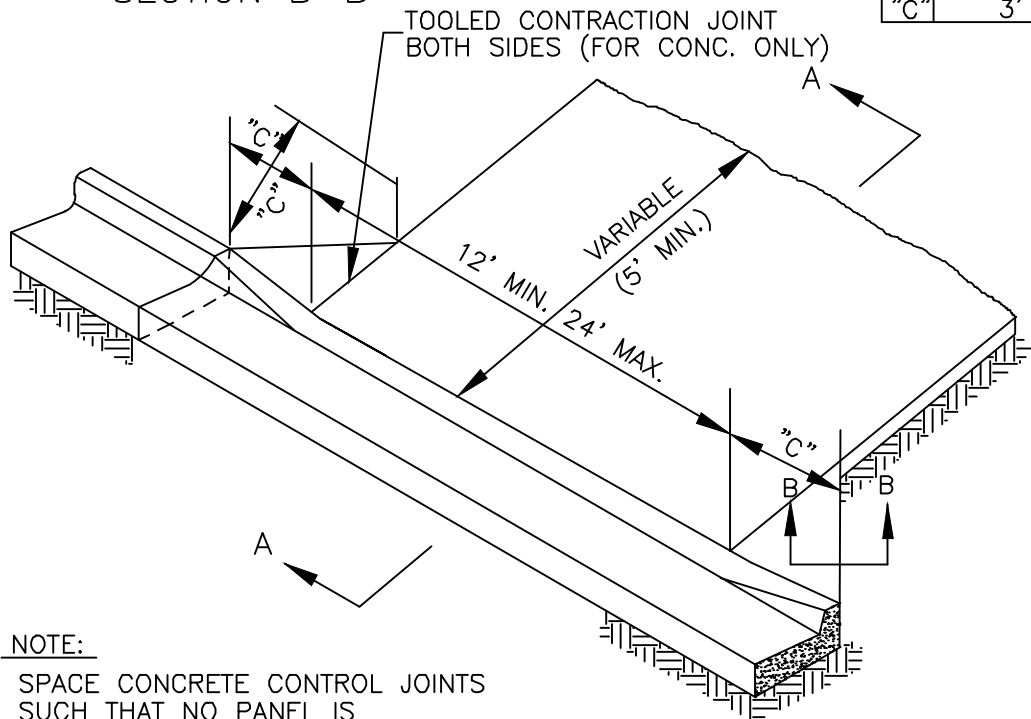

**NOTE:**

SPACE CONCRETE CONTROL JOINTS SUCH THAT NO PANEL IS GREATER THAN 100 SQUARE FEET.



STANDARD DETAILS  
RESIDENTIAL DRIVEWAY DETAIL  
CITY OF PLYMOUTH

PUBLISHED  
1-19

CITY PL. NO.  
STRT-13  
REVISED 3-13