


USE THIS BLOW OFF ASSEMBLY AT THE DEAD  
END OF A WATERMAIN IN LIEU OF A HYDRANT  
INSTALLATION.



PER WATERMAIN SPECIFICATION 02205.13 WATERMAIN STUBS PRESSURE RELIEVE PROVISION

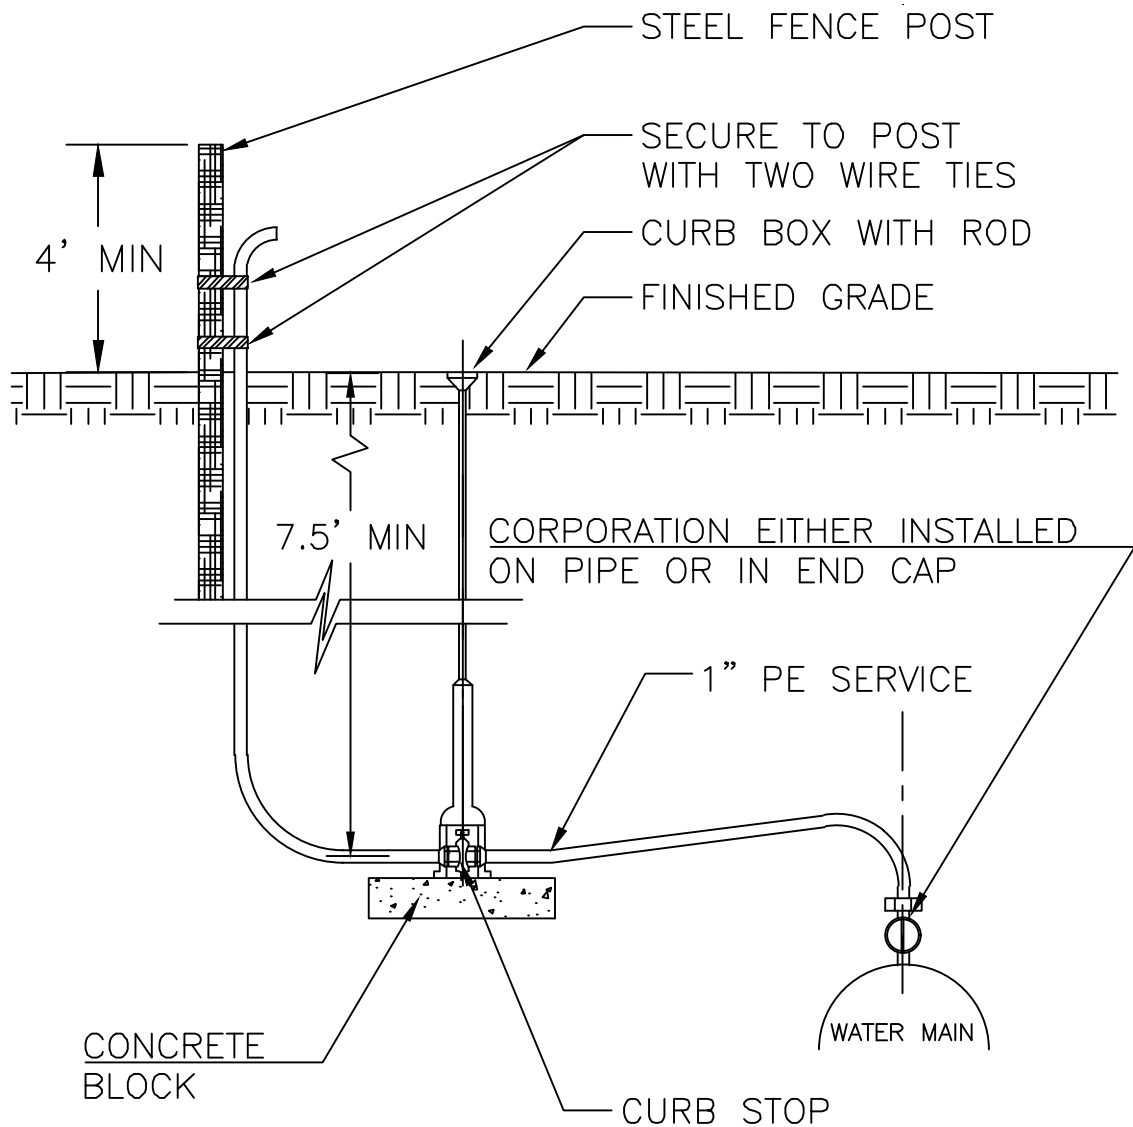

STANDARD DETAILS  
WATER MAIN STUB BLOW OFF DETAIL  
CITY OF PLYMOUTH

PUBLISHED  
1-19

CITY PL. NO.  
W-7  
REVISED 1-19